


BEDROOM EGRESS WINDOWS

Suite D, 180 North Third Avenue, Williams Lake , BC V2G 2A4 Unit 3 - 170 Cedar Avenue, Box 2260, 100 Mile House, BC V0K 2E0 102 - 410 Kinchant Street, Quesnel, BC V2J 7J5

Ph: 250-392-3351 Fax: 250-392-2812 Ph: 250-395-3838 Fax: 250-395-4898 Ph: 250-992-7400 Fax: 250-992-7414

BCBC - 9.9.10.1.

- 1. Except where the suite is sprinklered, each bedroom or combination bedroom shall have at least one outside window or exterior door openable from the inside without the use of keys, tools or special knowledge and without the removal of sashes or hardware.
- 2. The window referred to in Sentence (1) shall:
 - a) provide an unobstructed opening of not less than 0.35 m² (3.77 ft²) in area with no dimension less than 380 mm (15 in); and
 - b) maintain the required opening during an emergency without the need for additional support.

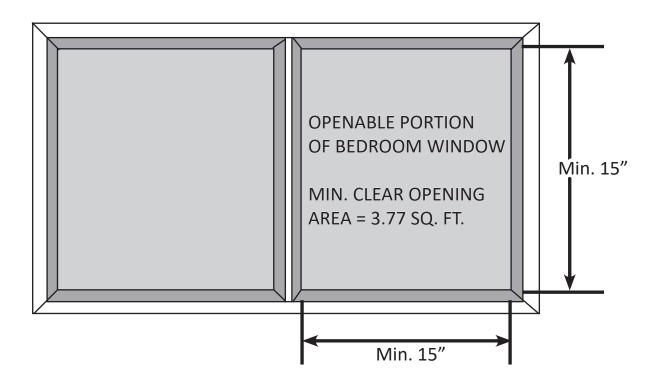

This information is provided for convenience only and is not in substitution of applicable CRD Bylaws or Provincial or Federal Codes or laws. You must satisfy yourself that any existing or proposed construction or other works complies with such Bylaws, Codes or other laws.




BEDROOM EGRESS WINDOWS

Suite D, 180 North Third Avenue, Williams Lake , BC V2G 2A4 Unit 3 - 170 Cedar Avenue, Box 2260, 100 Mile House, BC V0K 2E0 102 - 410 Kinchant Street, Quesnel, BC V2J 7J5 Ph: 250-392-3351 Fax: 250-392-2812 Ph: 250-395-3838 Fax: 250-395-4898 Ph: 250-992-7400 Fax: 250-992-7414

The BC Building Code requires each unsprinklered bedroom to have one outside window or door to be used as an emergency exit. Such windows and doors shall meet the following requirements:

- 1. Openable from the inside without the use of keys, tools or special knowledge and without the removal of sashes or hardware.
- 2. Unobstructed opening of not less than 0.35 m² (3.77 ft²) in area with no dimension less than 380 mm (15 in). An opening of 380 mm (15 in) x 920 mm (36 in) or 592 mm (23.3 in) x 592 mm would satisfy both requirements.
- 3. Maintain the required opening during an emergency without the need for additional support.
- 4. Where the egress window opens into a window well, a clearance of minimum 760 mm (30 in) must be provided in front of the window to allow a person to escape. Window with outward-opening owning needs additional clearance to provide the required 760 mm beyond th outer edge of the sash. The drawings from the BC Building Code that are reproduced below clarify this requirement.
- 5. Where the sash of the window swings towards the window well, the operation of the sash must not reduce the clearance in a manner that would restrict escape in an emergency. Hopper windows (bottom hinged operators) should not be used as egress window where the occupants have to climb over the glass.
- 6. Where a protective enclosure is installed over the window well the enclosure must be openable from the inside without the use of keys, tools or special knowledge of the opening mechanism.

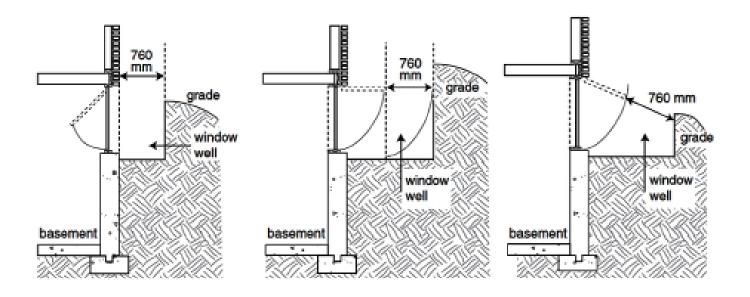

This information is provided for convenience only and is not in substitution of applicable CRD Bylaws or Provincial or Federal Codes or laws. You must satisfy yourself that any existing or proposed construction or other works complies with such Bylaws, Codes or other laws.